



2 WTC 75th FLOOR MER PLAN
0 16 32
SCALE IN FEET

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE JCC AND INSTALL TR-88 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 75th FLOOR MER RISER DIAGRAM, SEE DWG E-34.
4. FOR 75th FLOOR MER REMOVAL PLAN, SEE DWG E-38.

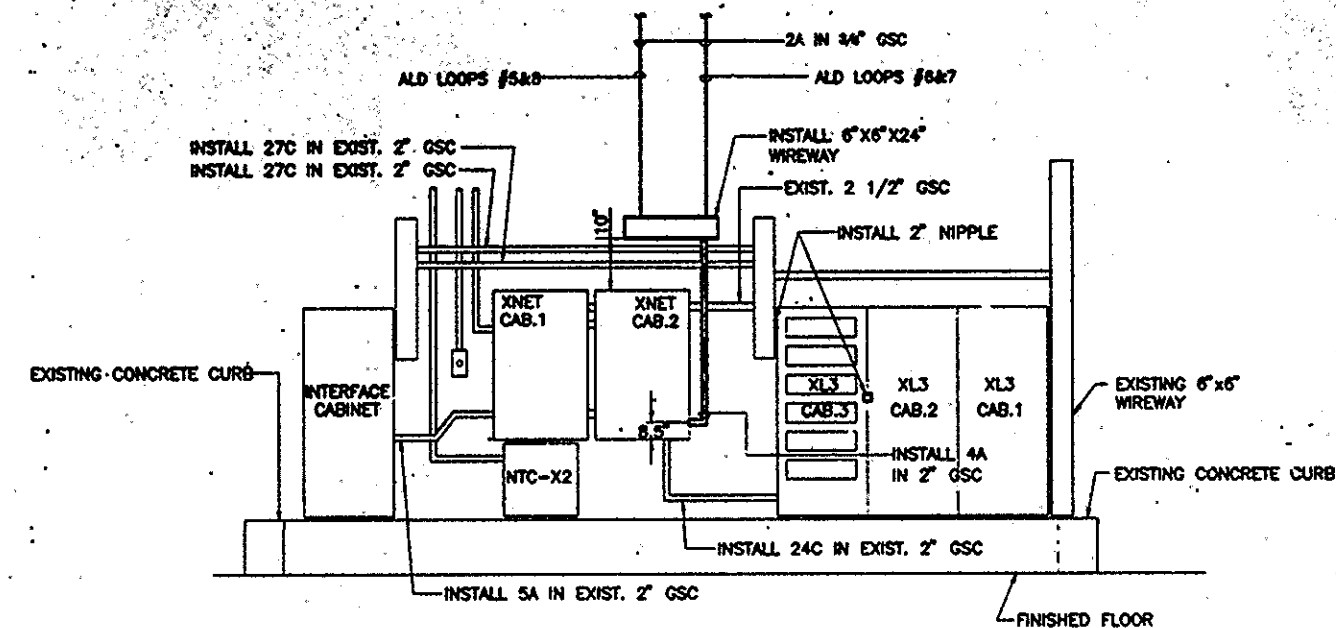


ELEVATION A-A
N.T.S.

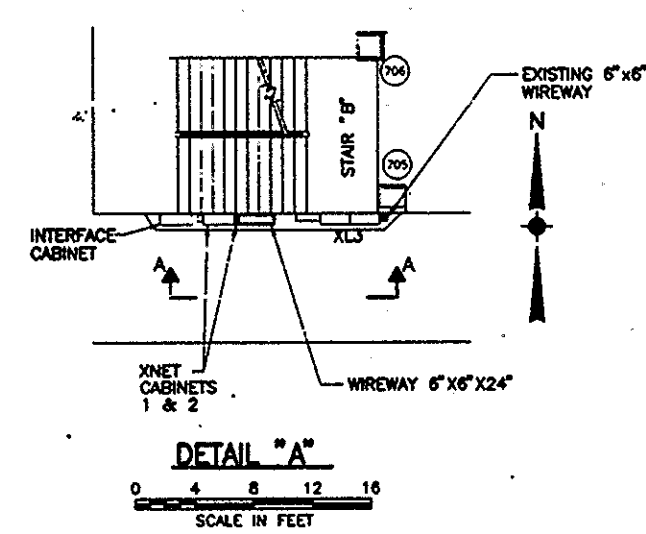

DETAIL "A"
0 4 8 12 16
SCALE IN FEET

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861-0824. THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.
DATE 2/1/00 [Signature]
DATE 2/3/00 [Signature]
ENGINEERING PROGRAM MGR.



THE PORT AUTHORITY
OPEN/001

ENGINEERING PROGRAM MANAGER
WORLD TRADE
[Signature]
CHIEF ELECTRICAL ENGINEER

No. Date Revision Approved

Engineering Department
Design Division
The World Trade Center

THE
FIRE ALARM SYSTEM
PHASE III
XLS CONVERSION
ELECTRICAL
2 WTC
75th FLOOR MER
PLAN

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.
ROYZMAN
FELDSTEIN
Designed by Drawn by Checked by

Date 5-20-99 Scale AS NOTED
Contract Number Drawing Number
WTC-861/92 E-35